


Project: _____
 Architect: _____
 Contractor: _____
 Supplier: _____

Dealer: _____
 Engineer: _____
 Location: _____
 Date: _____

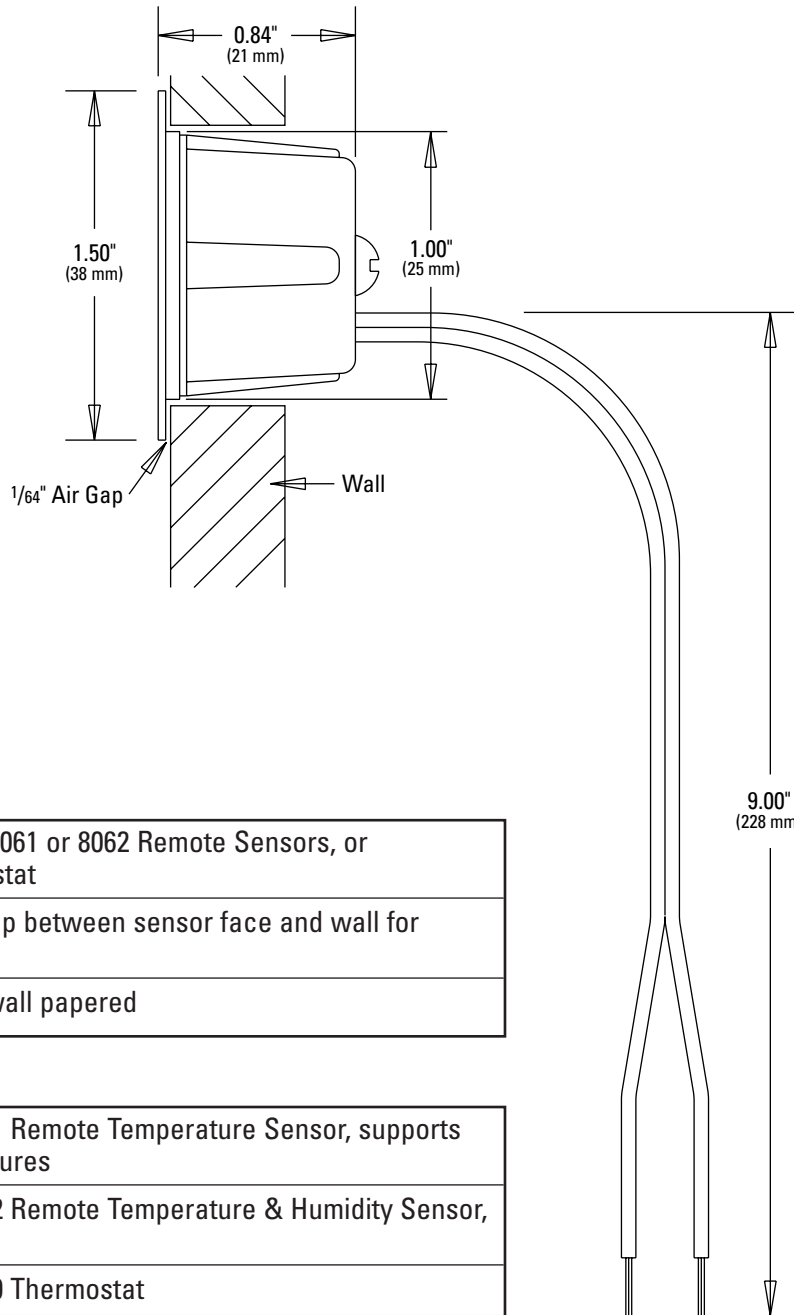

NOTES:

- Must be used with 8061 or 8062 Remote Sensors, or Model 8570 Thermostat
- Requires 1/64" air gap between sensor face and wall for proper operation
- May be painted or wall papered

Compatible with:

- Aprilaire Model 8061 Remote Temperature Sensor, supports 2 separate temperatures
- Aprilaire Model 8062 Remote Temperature & Humidity Sensor, control or monitor
- Aprilaire Model 8570 Thermostat

The submittal is intended to show general, overall product dimensions and provide guidance for installation clearance. Drawings are not to scale. Ensure submittals are current. Research Products reserves the right to make product changes without notification or obligation.