

- Switch settable from 1-1,023 seconds
- Works with anticipator thermostats

### MODE OF OPERATION

When power is applied to the input, the time delay begins. After the time delay is complete, the load energizes and remains energized as long as power is applied. The control is reset by removing power during or after the time delay period.

### SPECIFICATIONS

#### Input

- **Voltage:** 18-240 VAC
- **Frequency:** 50-60 Hz

#### Output

- **Output Ratings:**
  - **Maximum:** 1 amp
  - **Minimum:** 40 mA
  - **Inrush:** 10 amps


#### Time Delay

- 1-1,023 seconds, switch settable in 1-second increments

### INSTALLATION

1. Disconnect power.
2. Connect terminals in series with the starting device as shown in the wiring diagram below.
3. Select the desired time delay.
4. Reapply power, check operation.

### TIMING DIAGRAM

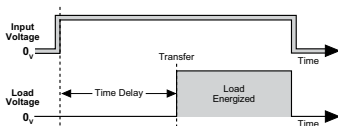

### WIRING DIAGRAM

